

Procurement for the Replacement of Major Components of Ventilation and Air Conditioning System at BCDA office, Bonifacio Technology Center

BID BULLETIN NO. 2

This Bid Bulletin clarifies the queries that were raised during the Pre-bid Conference on 30 March 2023 at 10:00 AM and queries sent through e-mail by prospective bidders, as well as other matters relative to the **Procurement for the Replacement of Major Components of Ventilation and Air Conditioning System at BCDA office, Bonifacio Technology Center**;

QUERIES	CLARIFICATION/S															
<p>1. Clarification on the item of scope of work, requesting for plan and location;</p> <p>Pressure sensor digital VAV controller and damper actuator as communicative compact solution for pressure-independent VAV and CAV systems in the comfort zone -NMV-D3-MP</p>	<p>Please refer to the Approved Terms of Reference.</p> <p>Attached as Annex A the location of VAV and Thermostat.</p>															
<p>2. Clarification on the technical specifications of VAV and the design of airflow rate from maximum to minimum</p>	<table border="1" data-bbox="802 1189 1385 1581"> <thead> <tr> <th>AHU</th> <th>Air Flow Rate (cubic meter/ hour)</th> <th>Total Cooling Capacity (TR)</th> </tr> </thead> <tbody> <tr> <td>AHU 24</td> <td>27818</td> <td>41</td> </tr> <tr> <td>AHU 25</td> <td>30452</td> <td>44</td> </tr> <tr> <td>AHU 26</td> <td>27846</td> <td>40</td> </tr> <tr> <td>AHU 27</td> <td>25543</td> <td>37</td> </tr> </tbody> </table>	AHU	Air Flow Rate (cubic meter/ hour)	Total Cooling Capacity (TR)	AHU 24	27818	41	AHU 25	30452	44	AHU 26	27846	40	AHU 27	25543	37
AHU	Air Flow Rate (cubic meter/ hour)	Total Cooling Capacity (TR)														
AHU 24	27818	41														
AHU 25	30452	44														
AHU 26	27846	40														
AHU 27	25543	37														

Please be reminded that all queries after the issuance of this Bid Bulletin will no longer be entertained.

Moreover, please take note of the following schedule:

Activities	Date/Schedule
Deadline for Request for Clarification, if any	14 April 2023 (Friday)
Issuance of Bid Bulletin, if any	17 April 2023 (Monday)
Deadline for Submission of the ff: <ul style="list-style-type: none">• Eligibility Requirements• Financial Proposal	24 April 2023 (Monday) at 12:00 PM
Opening of Bids	24 April 2023 (Monday) at 1:00 PM

The above changes further amend the bidding documents, accordingly. **The submission and opening of Bids will be conducted face-to-face at the BCDA Corporate Center, 2nd Floor, Bonifacio Technology Center, 31st St. corner 2nd Ave, Bonifacio Global City, Taguig City.** However, the bidders may opt to attend online via zoom.

For those attending in person, please consider the following guidelines:

- Attendees to the Pre-bid Conference and Opening of Bids are expected to follow the BCDA Health Protocols; and
- Observers/representatives who show signs of COVID-19 related symptoms are not allowed to enter the BCDA premises.

This Bid Bulletin is being issued pursuant to Sections 22.5.2 and 22.5.3 of the 2016 Revised Implementing Rules and Regulations of Republic Act No. 9184.


Issued on **17 April 2023 (Monday)**.

BIDS AND AWARDS COMMITTEE FOR GOODS

By:


RICHARD BRIAN M. CEPE
Chairperson

PROJECT: REPLACEMENT OF MAJOR COMPONENTS OF VENTILATION AND AIR CONDITIONING SYSTEM AT BCDA OFFICE, BTC

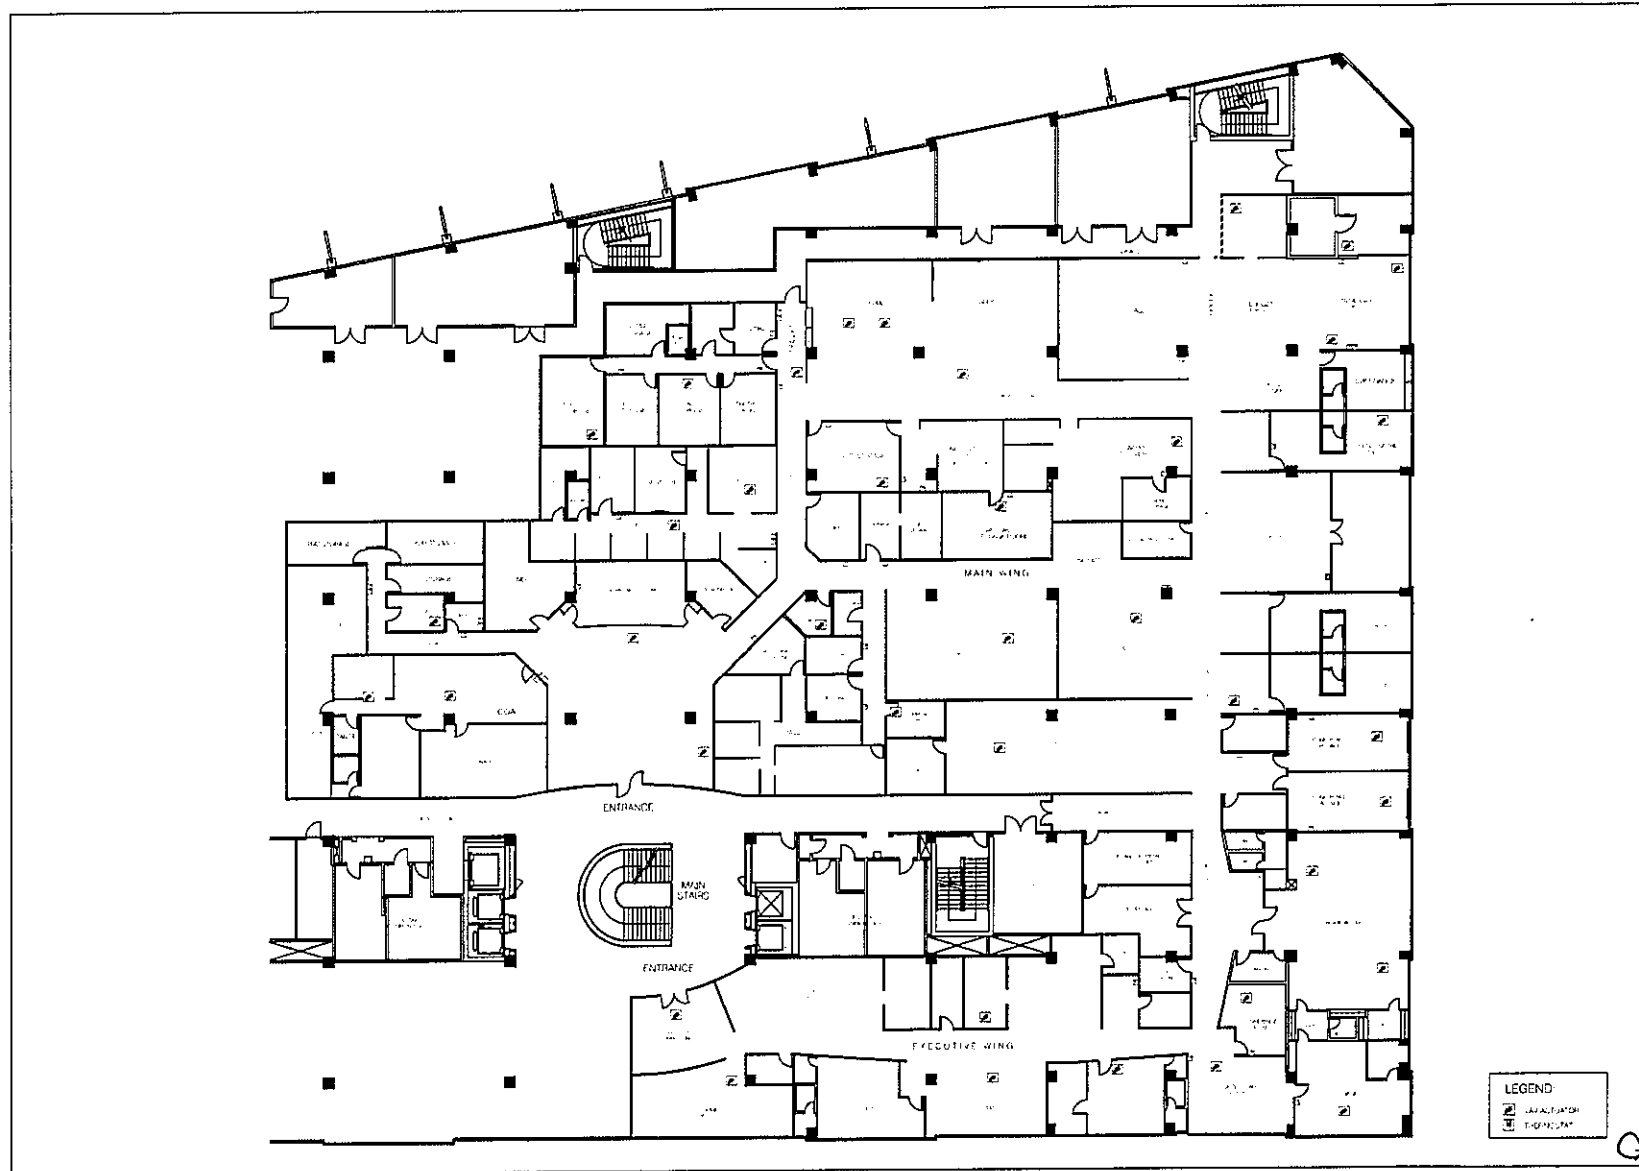

hd

LOCATION OF VAV AND THERMOSTAT

Handwritten initials and a number '71' are present in the bottom right corner of the page.